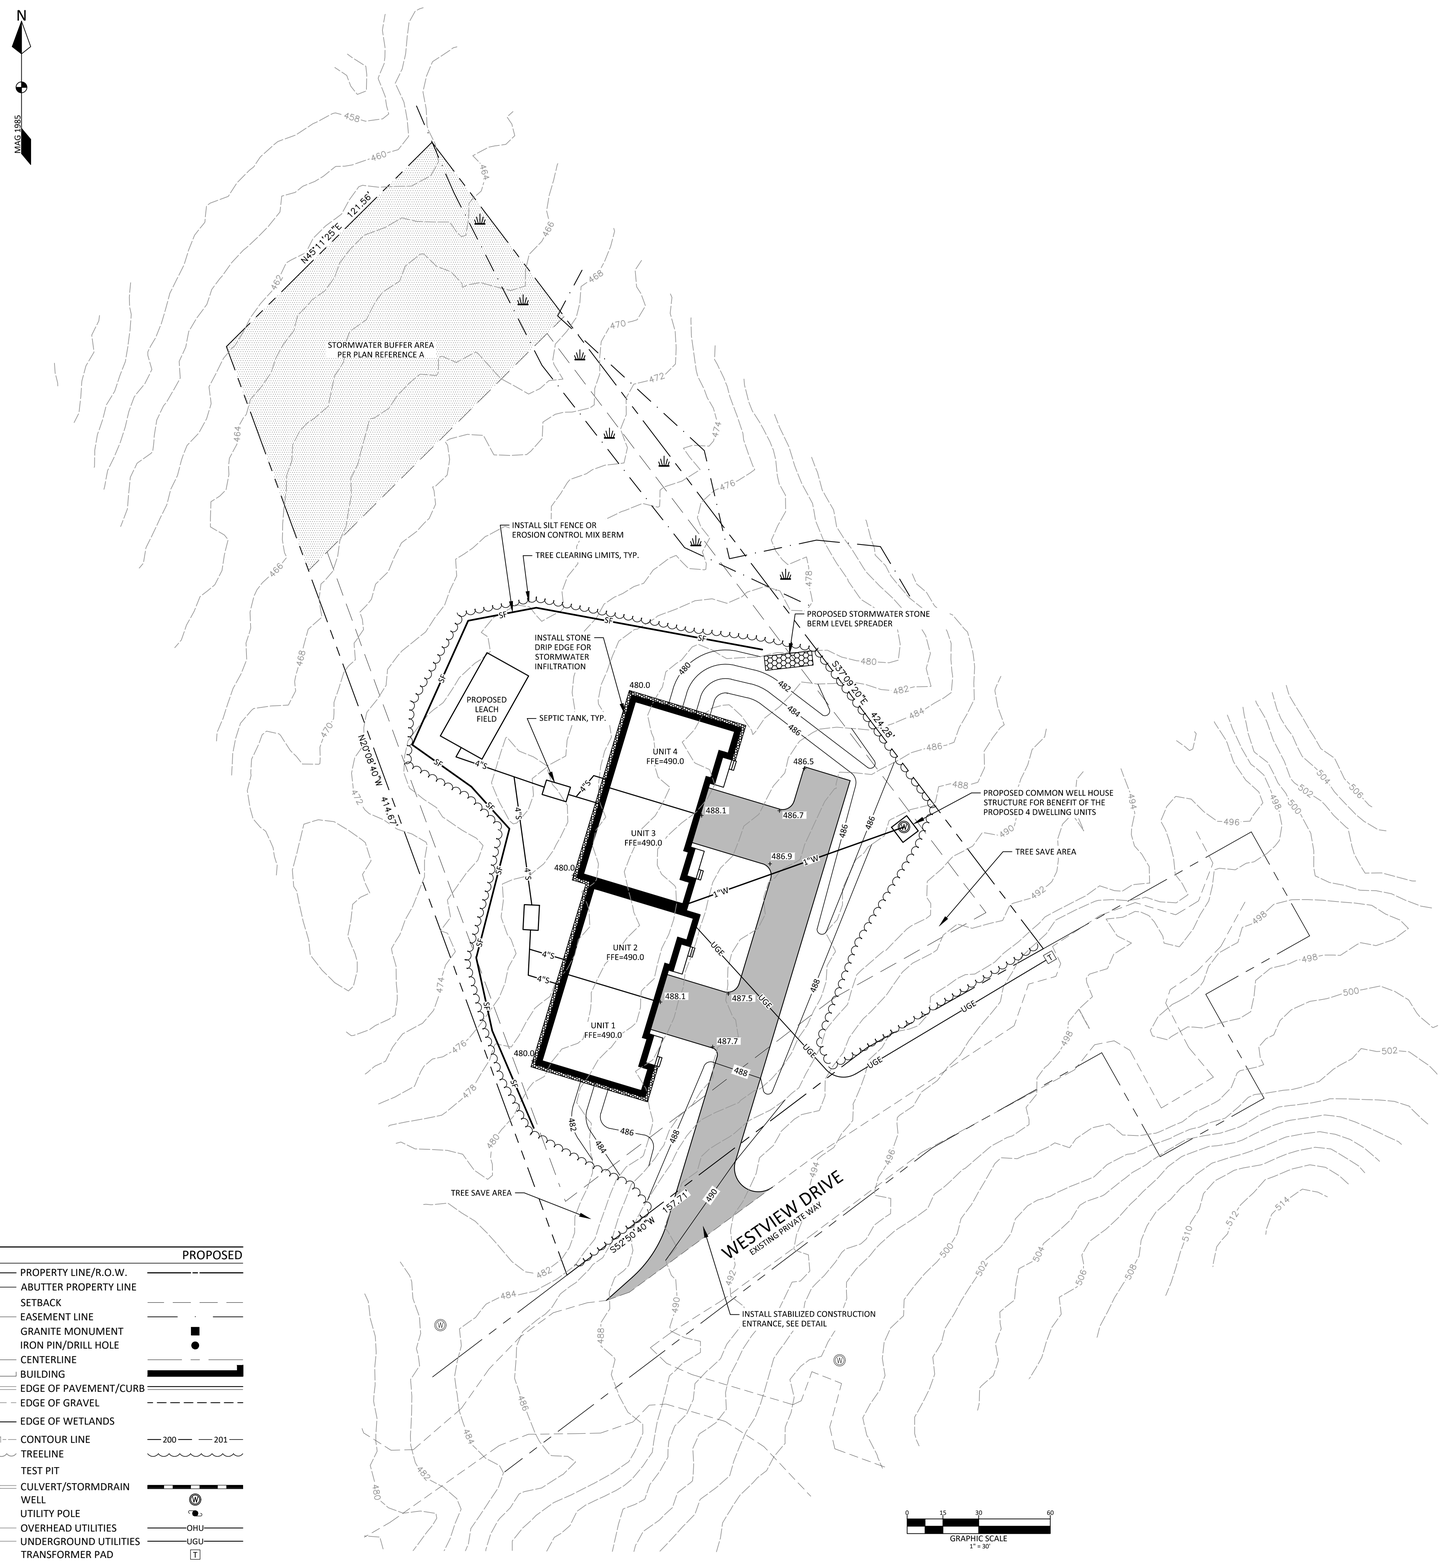

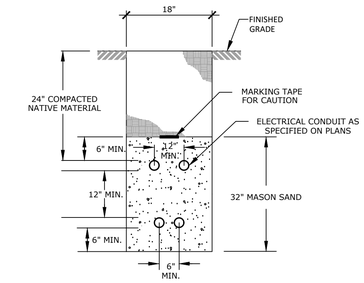

UTILITY TRENCH DETAIL

NOT TO SCALE

NOTES:

1. ALL CONDUITS SHALL BE 4" DIA. PVC SCH 40 EXCEPT FOR ROAD CROSSINGS SHALL BE PVC SCH 80
2. INSTALLATION SHOULD NOT ALLOW THE INTER-TWINING OF CABLES.
3. BEDDING AND BACKFILL SHALL BE FREE OF ROOTS, STUMPS AND OTHER DEBRIS.
4. COMMUNICATION CABLE AND POWER CABLE SHALL HAVE NO LESS THAN 12 INCHES OF RADIAL SEPARATION.

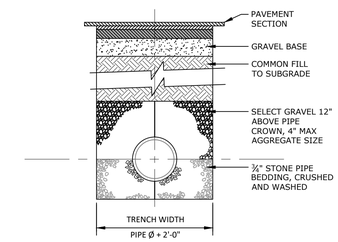

TYPICAL TRENCH SECTION

NOT TO SCALE

LEGEND

EXISTING		PROPOSED
	PROPERTY LINE/R.O.W.	
	ABUTTER PROPERTY LINE	
	SETBACK	
	EASEMENT LINE	
	GRANITE MONUMENT	
	IRON PIN/DRILL HOLE	
	CENTERLINE	
	BUILDING	
	EDGE OF PAVEMENT/CURB	
	EDGE OF GRAVEL	
	EDGE OF WETLANDS	
200 201	CONTOUR LINE	200 201
	TREELINE	
TP-1	TEST PIT	
	CULVERT/STORMDRAIN	
W	WELL	W
	UTILITY POLE	
OHU	OVERHEAD UTILITIES	OHU
UGU	UNDERGROUND UTILITIES	UGU
	TRANSFORMER PAD	T

STATE OF MAINE
DUSTIN M. ROMA
REG. No. 12131
PROFESSIONAL ENGINEER
5-11-2022

DM ROMA
CONSULTING ENGINEERS
P.O. BOX 1116
WINDHAM, ME 04062
(207) 591-5055

REV.	DATE	BY	DESCRIPTION

GRADING & UTILITY PLAN

LOT 48D ON WESTVIEW DRIVE

WESTVIEW DRIVE
RAYMOND, MAINE

FOR:
DAIGLE FINANCIAL AND DEVELOPMENT, LLC
85 NASH ROAD
WINDHAM, ME 04062

22015
JOB NUMBER:

1" = 30'
SCALE:

5-11-2022
DATE:

SHEET 2 OF 3

GU-1